

Intertek



Intertek

The ASTA Diamond Mark is a symbol of electrical safety. It provides evidence for customers and authorities that Intertek has independently tested and certified the product's compliance to applicable safety standards, also that Intertek monitors production and testing to ensure subsequent production continues to comply with stated standards.

This Licence is valid until the review date or earlier if preceded by the withdrawal of the Approval Standard or otherwise withdrawn by the Certification Body. Current validity status can be confirmed by contacting: Intertek
Hilton House,
Corporation Street,
Rugby, CV21 2DN
United Kingdom
Tel: +44 (0)1788 578435
asta@intertek.com

Details of Approved variants, components and sites are given on Endorsements to this Licence (3 pages)

ASTA Licence

This Licence authorises use of the

ASTA Diamond Mark

Licence No. 702

Organisation:

Legrand Electric Limited

No. 1 Industrial Estate, Medomsley Road, Consett, County Durham, DH8 6SR

Product:

Designation:

Colour(s):
240 / 415 Volts a.c. 50 Hz
Rated current:

I_{cc} :

I_{cw} & I_{pk} , 1Ø & 3Ø:

Track Feed Units

Approval Standard:

Busbar Trunking System

Electrak 30, 31, 32 & 33

White & Grey
IP4X or IP54
Powertrack - 16, 25 & 40 Amperes
Tap-off - 16 A (1Ø & 3Ø, fused/unfused)
16kA per phase/busbar
16A BTS 0.40kA rms, 1 sec, 0.60kA pk
25A BTS 0.65kA rms, 1 sec, 0.975kA pk
40A BTS 1.0kA rms, 1 sec, 1.5kA pk
Single or double sided Powertrack
BS EN 60439-2: 2000, EN 60439-2: 2000 &
IEC 60439-2: 2000

Issue number:

8

Review date:

31st December 2012

Factory Reference:

LQ-12

R W Hayward

Name

Signature

20th December 2011

Date



010



ASTA Licence No. 702, Endorsement 1 of 3
 Product: Busbar Trunking System
 Designation: Electrak 30, 31, 32 & 33

Approved sites for manufacture/production:

Components & Assembly – Legrand Electric Limited
 No. 1 Industrial Estate
 Medomsley Road
 Consett
 County Durham
 DH8 6SR

Conditions for maintenance of Licence:

- 1) Compliance with Certification Regulations.
- 2) Inspection of manufacturing facilities each year with satisfactory outcome.
- 3) Surveillance testing of production samples at required intervals with satisfactory outcome.
- 4) Satisfactory actions in the event of any compliance and/or safety issues becoming known after product has been supplied.
- 5) Prompt payment of invoices.

Licence Renewal:

Licence fee will be invoiced annually during the month of March.
 The Licence document will be reissued following any changes advised or variants tested.
 A fee may be charged for reissue.

Surveillance samples:

Samples are required to be tested in accordance with Intertek surveillance testing programmes.
 Samples should preferably be selected during scheduled Factory inspection visits.
 The fee for testing will be invoiced at the time of testing. A summary of testing will be provided.

Use of the ASTA Mark:

The ASTA Mark may be used on the product and in marketing material relating to the product, as permitted by the Certification Regulations.
 The Licence number should be marked on the product (mandatory on BS 1363 plugs, where feasible on other products) in a form agreed by Intertek, such as "Approved by ASTA Licence no. 702".

Marketing of product with alternative designation(s) or brand name(s):

This Licence relates only to products specifically described herein. Any alternative designations and/or brand names should be advised to Intertek. The Licence will then be reissued accordingly. Alternative brand names (if applicable) are shown on an Annex to this Licence.

Compliance Testing:

Reason for test	ASTA certificate
Complete compliance	14858




ASTA Licence No. 702, Endorsement 2 of 3
 Product: Busbar Trunking System
 Designation: Electrak 30, 31, 32 & 33

PRODUCT VARIATIONS

Product Specification: 240 / 415 Volts, 50 Hz.
 Powertrak Rating: 16, 25 & 40 Amperes

Electrak 30	2P + E
Electrak 31	3P + E
Electrak 32	Dual Circuit
Electrak 33	4P + E

Track Variations

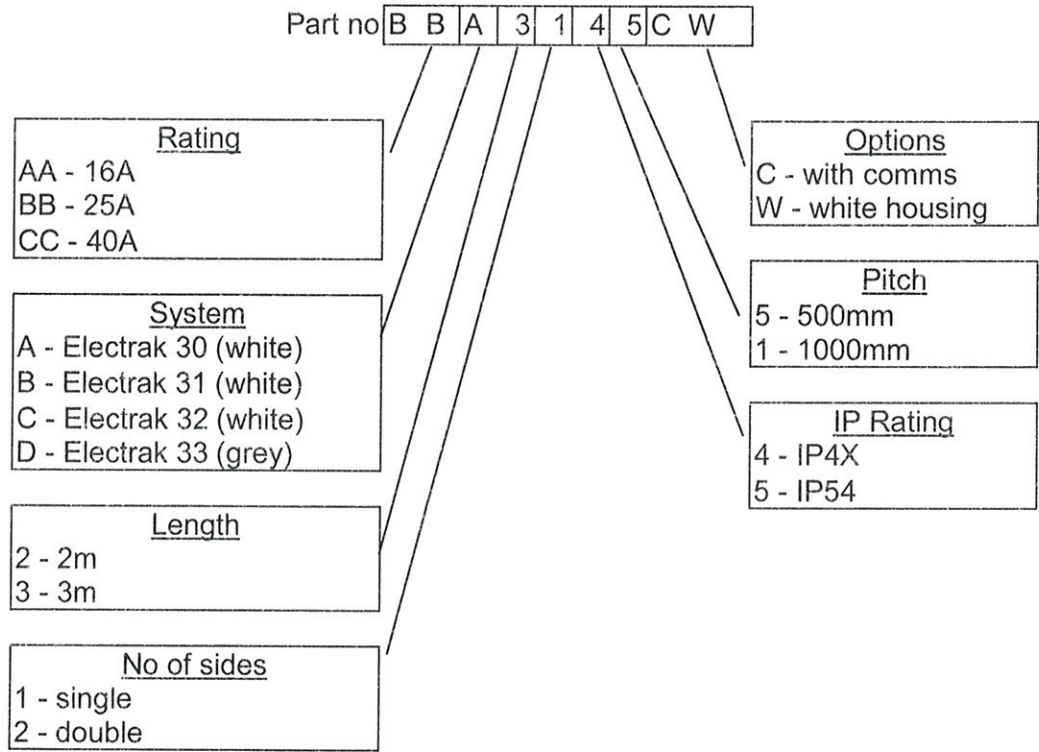




ASTA Licence No. 702, Endorsement 3 of 3

Product: Busbar Trunking System

Designation: Electrak 30, 31, 32 & 33

Tap-off Variations

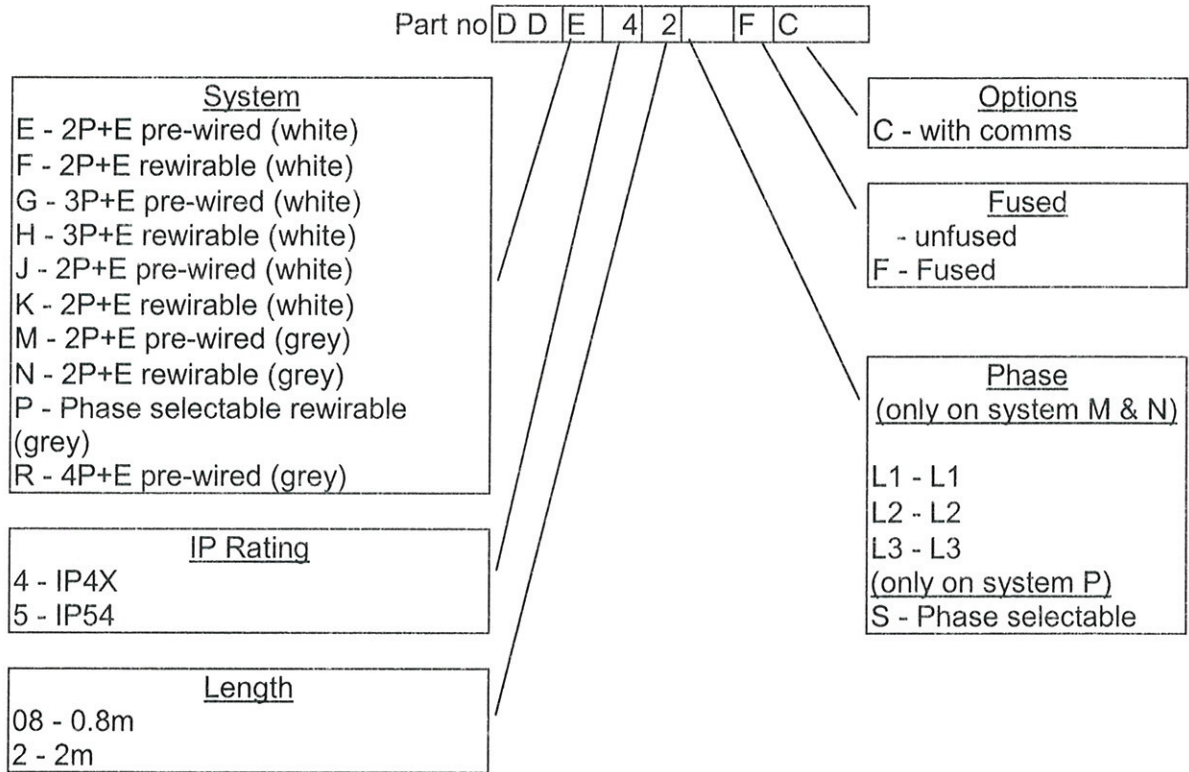

Feed unit Variations

